



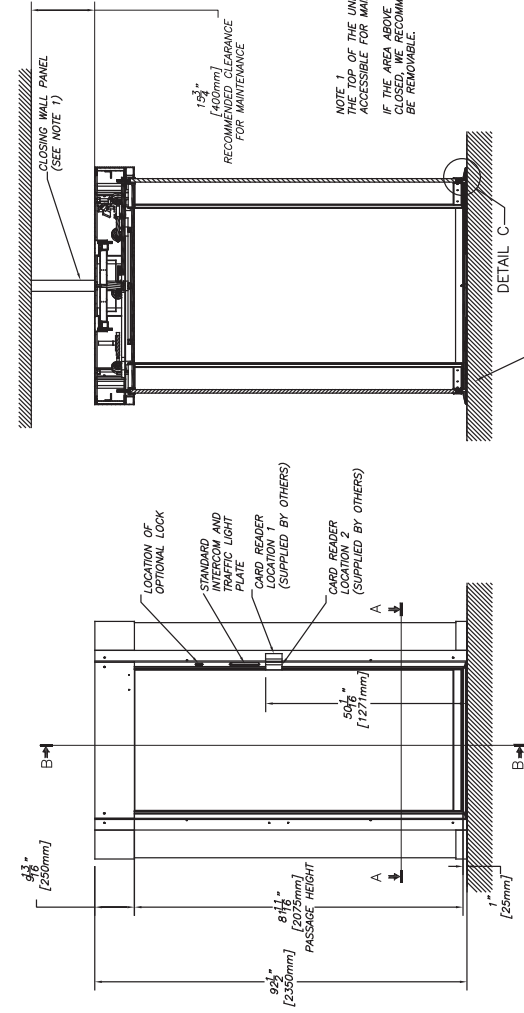


POWER SUPPLY
120V MONO+GND 3 WIRES 12GA
CONTROL CABLES:
-CONTROL CONSOLE
UNIT COMES WITH 82 FEET (25m) OF CABLE
-CARD READER (NOT SUPPLIED)
THE CONTROL CABLES AND THE POWER
SUPPLY CABLE SHOULD RUN IN SEPARATE
CONDUITS.
THE CONDUITS SHOULD ENTER THE
CLOSET FROM THE TOP

NOTE 1
THE TOP OF THE UNIT NEEDS TO BE
ACCESSIBLE FOR MAINTENANCE.

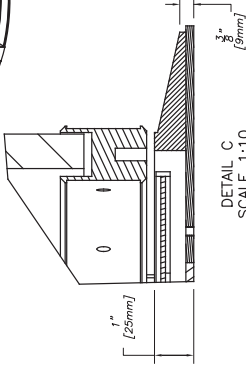


OPTIONAL WALL BRACKET AVAILABLE

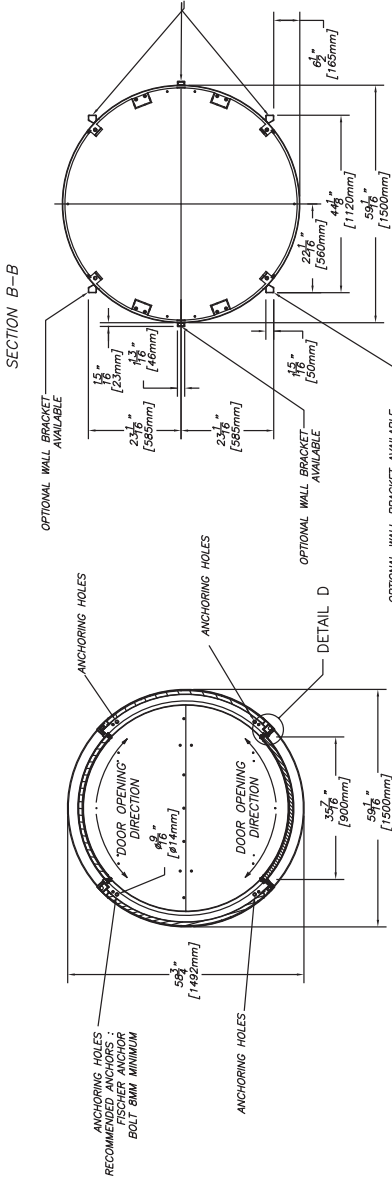

SECTION A-A

DIRECTION (B)
EXIT

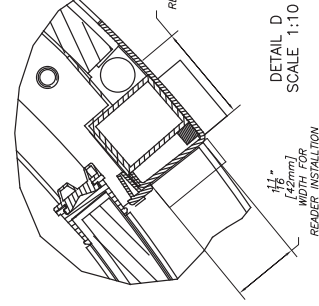

DETAIL D
SCALE 1:10

MATÉRIAU/MATERIAL	—
TRAITEMENT/TREATMENT	—
FINI/FINISH	—
NR./Nº.	POIDS/WEIGHT
—	—
	SURFACE
	—

						LFA/OH/
						OHA/SSA
						SSA
						PAR/BY
D		2019/07/23	DOOR DIMENSIONS 850mm TO 900mm			
C		2018/08/13	GENERAL MODIFICATIONS			
B		2018/05/03	Reader height dimension indicate top			
REV		DATE	MODIFICATIONS / CHANGES			
			REVISIONS			

AUTOMATIC SYSTEMS AMERICA INC. MAKES NO REPRESENTATIONS AS TO THE PROPER POSITIONING OF THE CLEARLOCK AT THE INSTALLATION LOCATION, ESTABLISHING THE PLACEMENT AND LAYOUT OF THE DEVICES AND DETERMINING COMPLIANCE WITH THE APPLICABLE BUILDING CODES. OTHER CODES, LAWS AND REGULATIONS IS THE SOLE RESPONSIBILITY OF THE PURCHASER. INSTALLATION MUST BE PERFORMED BY A QUALIFIED INSTALLER FOLLOWING MANUFACTURER'S INSTRUCTIONS. OTHERWISE AUTOMATIC SYSTEMS AMERICA INC.'S WARRANTIES MAY BE VOID.

LES DIMENSIONS SONT EN POUCES / DIMENSIONS ARE IN INCHES	TOLERANCES	SAUF SI INDIQUE UNLESS OTHERWISE NOTED
	XXX ± .005	
	XX ± .010	
	X ± .015	
	FRA. ± 1/32	
	ANGLES ± 1/2°	

TITRE	IMPLEMENTATION LAYOUT
-------	-----------------------

CLARK LOCK 007		ÉCHELLE/SCALE N/A
DESSINÉ PAR DRAWN BY	KGA	VÉRIFIÉ PAR CHECKED BY

EBARBER & ENLEVER
LES ARÊTES VIVES.
DIM SELON ASME Y14.5
1994. NE PAS MESURER
SUR LE DESSIN

BREAK ALL SHARP
EDGES AND CORNERS.
ALL DIM PER ASME
Y14.5 1994. DO NOT
SCALE DRAWING

SECTION LAYOUT

ÉCHELLE/SCALE
N/A



**AUTOMATIC
SYSTEMS**

FOHER / FILENAME	NAM-CL637-IN-01-EN.DWG
------------------	------------------------

3