

1- TRILANE NOTES:

**-ALL WIRING MUST MEET OR EXCEED STANDARDS,
CODES AND MUST BE INSTALLED BY A CERTIFIED TECHNICIAN.**

-ANCHORAGE: FIXED WITH CLAMPS.

-1/2" X 5 1/2" ANCHORING FURNISHED BY ASA. (DRILL SIZE ø1/2")

-RESPECT ALL STANDARDS AND LAWS APPLICABLE WHERE THE PRODUCT WILL BE INSTALLED.

CABLE NOTE:


-THIS WORK IS TO BE CONSIDERED BY THE CUSTOMER.

-ALL CABLES MUST EXCEED THE GROUND BY 10'.

-A PULL CABLE MUST BE CONSIDERED BETWEEN EACH GATE.

2- AL933 NOTES:


-FOR ACCESSLANE INSTALLATION REFER TO
NAM-AL93X-IN-01-BI

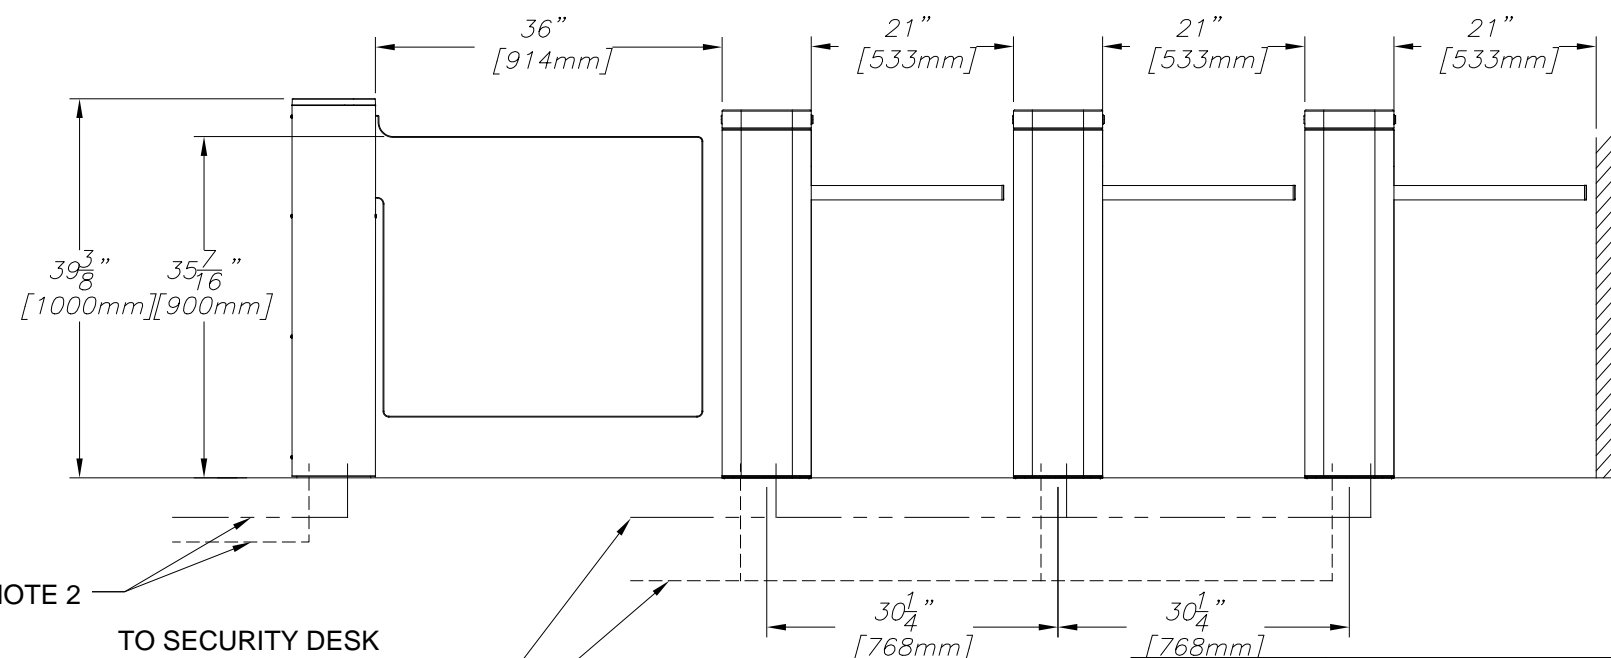

SEE NOTE 2

TO SECURITY DESK
(COMMUNICATION CABLE)
CONDUIT: PVC 1/2" OR 3/4"

TO ELECTRICAL PANEL
3 CIRCUITS ARE NEEDED
1 CIRCUIT BY LANE
CONDUIT: PVC 1/2" OR 3/4"

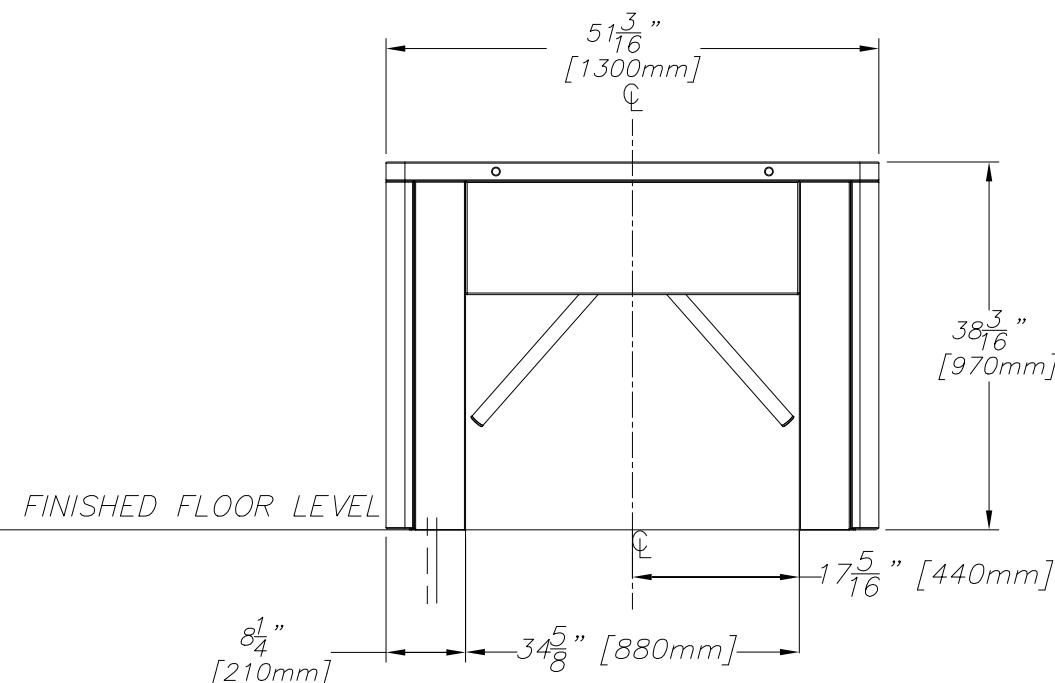


D.	G	-	-
	REV	DATE	MODIFICATIONS/CHANGES
			PAR/BY

MATÉRIAU/MATERIAL		
TRAITEMENT/TREATMENT		
FINI/FINISH		
NB./App.	POIDS/WEIGHT	SURFACE

LES INFORMATIONS CONTENUES SUR LES DESSINS DE ASA Inc.
 SONT CONFIDENTIELLES ET SONT LA PROPRIÉTÉ DE ASA Inc.
 TOUTES REPRODUCTIONS, DISTRIBUTIONS OU UTILISATIONS
 SONT INTERDITES SANS LA PERMISSION DE ASA Inc.

INFORMATION DISCLOSED HERE IS CONFIDENTIAL AND IS THE
 PROPERTY OF ASA Inc., ANY REPRODUCTION, DISTRIBUTION OR
 USE IS PROHIBITED WITHOUT A WRITTEN CONSENT BY ASA Inc.

LES DIMENSIONS SONT EN POUCHES / DIMENSIONS ARE IN INCHES	
TOLERANCES	
.XXX	± .005
.XX	± .010
.X	± .015
FRAÇ.	± 1/32
ANGLES	±1/2"
SAUF SI INDICUÉS UNLESS OTHERWISE NOTED	
TITRE TITLE	
	
DESSINÉ PAR DRAWN BY	
JPS	


EBARBER & ENLEVER
LES ARÊTES VIVES.
DIM SELON ASME Y14.5
1994. NE PAS MESURER
SUR LE DESSIN

BREAK ALL SHARP
EDGES AND CORNERS.
ALL DIM PER ASME
Y14.5 1994. DO NOT
SCALE DRAWING

ON 3 TL2, WITH

ÉCHELLE/SCALE
N/A

VÉRIFIÉ PAR
CHECKED BY

			
FICHER / FILENAME			
NAM-TL2-IN-001-EN.DWG			
& ACCESSLANE 933			
FORMAT/SIZE	DATE	FEUILLE/SHEET	DE/OF
B	2018/11/02	1	1
NO. DE DESSIN/DWG. NO.			REV
BO NAM-TL2-IN-001-EN			A

AUTOMATIC SYSTEMS MAKES NO REPRESENTATION AS TO THE PROPER POSITIONING OF THE TURNSTILES AT THE INSTALLATION LOCATION. ESTABLISHING THE LAYOUT AND PLACEMENT OF THE UNIT(S) AND DETERMINING COMPLIANCE WITH THE APPLICABLE BUILDING CODES, OTHER CODES, LAWS AND REGULATIONS IS THE SOLE RESPONSIBILITY OF THE PURCHASER. INSTALLATION MUST BE PERFORMED BY A QUALIFIED INSTALLER FOLLOWING MANUFACTURER'S INSTRUCTIONS. OTHERWISE AUTOMATIC SYSTEMS' WARRANTIES MAY BE VOID